


Dominion Virginia Power Approved Part# PTCDV1

DWG. TITLE:	Power Termination Cabinet
DWG. NO.:	400A / Part No. PTCDV-1
MATERIAL:	14 Ga. Galvanized ASTM A924 - G90-U
FINISH:	N/A
DWG. NO.:	P10102

NOTICE: THIS INFORMATION IS THE PROPERTY OF M.J. SULLIVAN CO. ANY REPRODUCTION, PUBLICATION OR DISTRIBUTION TO A THIRD PARTY IS STRICTLY FORBIDDEN UNLESS WRITTEN PERMISSIONS ARE GIVEN BY AN AUTHORIZED AGENT OF:	
N.J. SULLIVAN CO., INC.	
DFTG.:	DATE: 12/8/11
CHKR.:	DATE:
REV.:	DATE:
REV.:	DATE:
REV.:	DATE:

**SULLIVAN**  
 INCORPORATED  
 P.O. BOX 438, STERLING, VIRGINIA 20167  
 METAL FABRICATION  
 Phone: (703)-464-5944 Fax: (703)-464-5992  
 www.mjsullivan.com



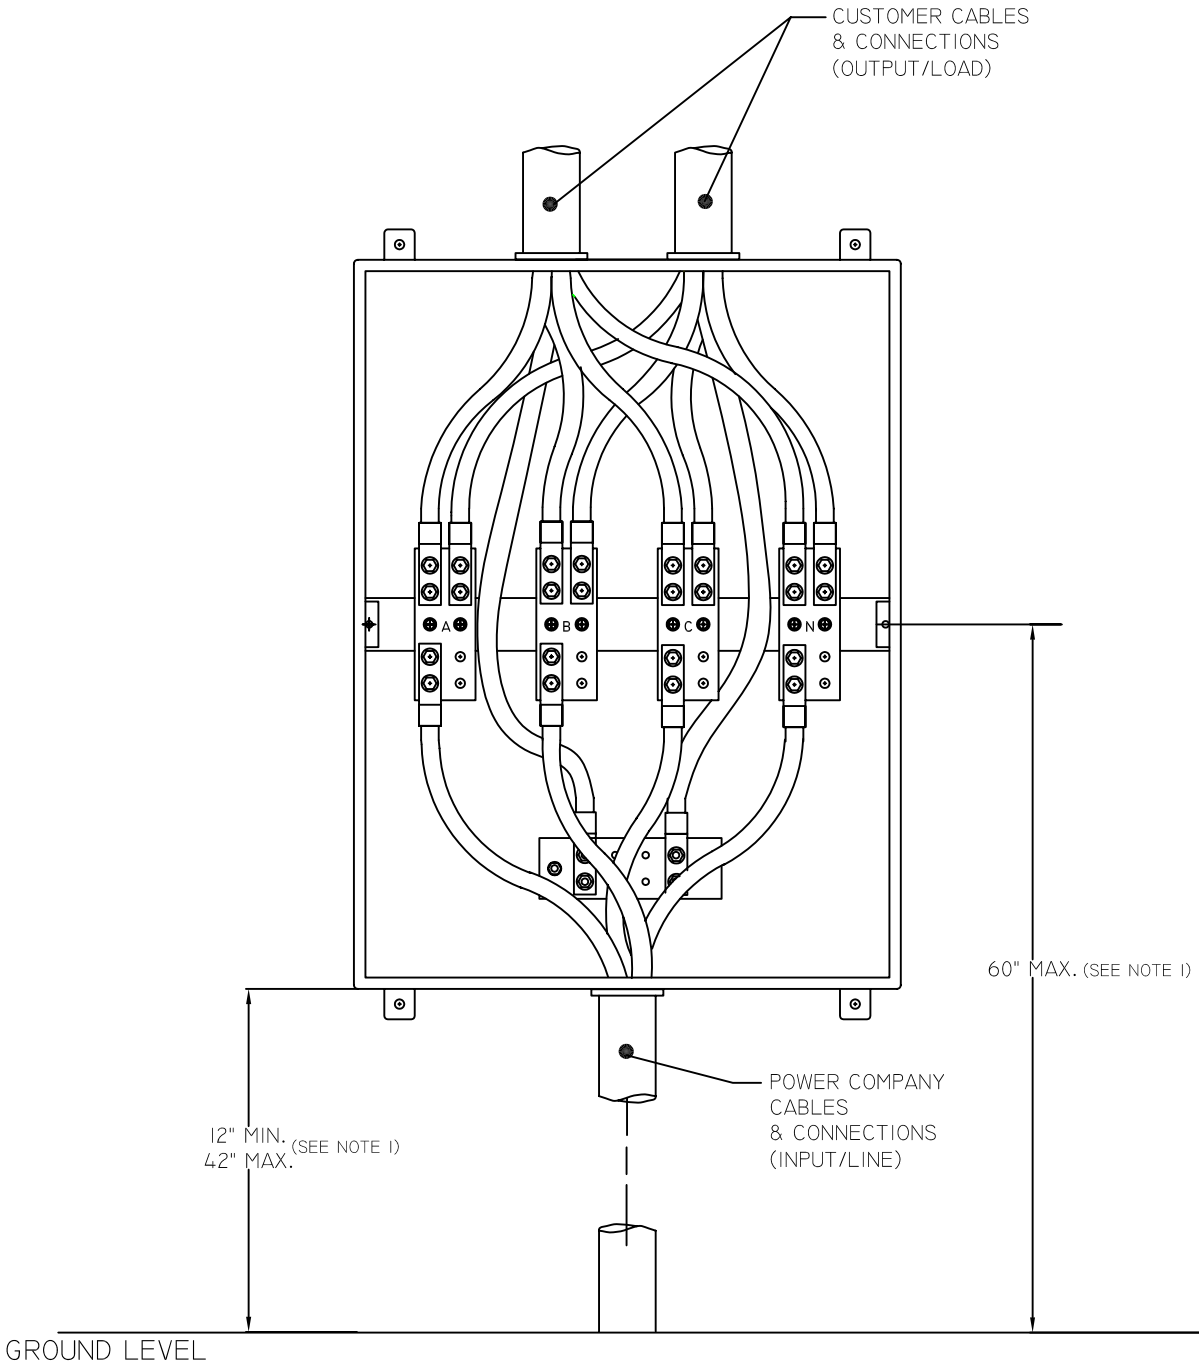

TYPICAL INSTALLATION

NOTE 1 - VERIFY MOUNTING HEIGHTS WITH LOCAL POWER COMPANY REQUIREMENTS.

DWG. TITLE:	Typical Installation PTCDV-1/2/3
DWG. NO.:	P10101
MATERIAL:	PTCDV Install
FINISH:	

NOTICE: THIS INFORMATION IS THE PROPERTY OF N.J. SULLIVAN CO., ANY REPRODUCTION, PUBLICATION OR DISTRIBUTION TO A THIRD PARTY IS STRICTLY FORBIDDEN UNLESS WRITTEN PERMISSIONS ARE GIVEN BY AN AUTHORIZED AGENT OF: N.J. SULLIVAN CO., INC.		
DFTG.:	CD	DATE: 12/8/11
CHKR.:		DATE:
REV.:		DATE:
REV.:		DATE:
REV.:		DATE:

**N.J. SULLIVAN Co.**  
INCORPORATED  
P.O. BOX 438, STERLING, VIRGINIA 20167  
METAL FABRICATION  
Phone: (703)-464-5944 Fax: (703)-464-5992  
www.njsullivan.com

## Dominion Virginia Power Termination Cabinets Notes

1 - CABINET FABRICATION IS A WELDED CONSTRUCTION IN ACCORDANCE WITH NEMA TYPE 3R SPECIFICATIONS. MATERIAL IS 14 GAUGE (PART NO. PTCDV1) AND 12 GAUGE (PART NOS. PTCDV-2/3/4) G-90U GRADE GALVANIZED STEEL IN ACCORDANCE WITH ASTM A924 - G90-U. ALL JOINTS AND SEAMS ARE WELDED THEN REFINISHED WITH GALVANIC COATING TO PRESERVE FINISH.

2 - BUSS BAR MOUNTING CHANNELS ARE FABRICATED FROM 12 GAUGE G-90U GRADE GALVANIZED STEEL IN ACCORDANCE WITH ASTM A924.

3 - BUSS BARS ARE FABRICATED FROM ALUMINUM ALLOY BAR STOCK, 1/4" THICK, 6101-T61 IN ACCORDANCE WITH ASTM B317. MINIMUM ELECTRICAL CONDUCTIVITY AT 20° C % IACS IS 57%. BUSS BARS ARE PUNCHED TO ACCOMMODATE STANDARD 2 HOLE HIGH-PRESS LUGS.

4 - ALL STANDOFF INSULATORS ARE MOLDED OF UL RECOGNIZED FLAME RESISTANT FIBERGLASS-REINFORCED THERMOSET POLYESTER MOLDING COMPOUND WITH THREADED INSERTS AT EACH END. UL RECOGNIZED ACCORDING TO UL STANDARD FOR SAFETY 891. VOLTAGE RATING FOR STANDOFFS USED ON PART NOS. PTCDV-1/2/3 600V; PART NO. PTCDV-4, 2300V.

5 - GRADE 5 PLATED STEEL HARDWARE FOR LUG CONNECTIONS IS PROVIDED.

6 - ALTERNATE CONFIGURATIONS OF CABINETS, CHANNELS, AND BUSS BARS MAY BE PROVIDED TO MEET YOUR REQUIREMENTS UPON REQUEST.

7 - POWER TERMINATION CABINETS ARE 600 VOLT CLASS.

8 - ALL POWER TERMINATION CABINETS ARE UL LABELED.

PART NUMBER	USAGE	AMPERAGE RATING	CONDUCTORS PER PHASE	CABINET DIMENSIONS		
				HEIGHT	WIDTH	DEPTH
PTCDV-1	INDOOR/ OUTDOOR	0 - 400	4- MAX	36"	30"	13"
PTCDV-2	INDOOR/ OUTDOOR	401 - 1200	4- MAX	48"	36"	14"
PTCDV-3	INDOOR/ OUTDOOR	1201 - 3000	6- MAX	60"	48"	19"
PTCDV-4	INDOOR/ OUTDOOR	3001-4000	12- MAX	91.5"	48"	30"



DWG. TITLE: Power Termination Cabinet PTCDV1 - PTCDV4  
for Dominion Virginia Power Specifications

DWG. NO.: P10100

MATERIAL: Specifications

FINISH:

NOTICE:  
THIS INFORMATION IS THE PROPERTY OF N.J. SULLIVAN CO., ANY REPRODUCTION, PUBLICATION OR DISTRIBUTION TO A THIRD PARTY IS STRICTLY FORBIDDEN UNLESS WRITTEN PERMISSIONS ARE GIVEN BY AN AUTHORIZED AGENT OF:  
N.J. SULLIVAN CO., INC.

DFTG.:	CD	DATE:	12/8/11
CHKR.:		DATE:	
REV.:		DATE:	
REV.:		DATE:	
REV.:		DATE:	

**N.J.**  
**SULLIVAN Co.**

INCORPORATED  
P.O. BOX 438, STERLING, VIRGINIA 20167  
METAL FABRICATION

Phone: (703)-464-5944 Fax: (703)-464-5992  
www.njsullivan.com